
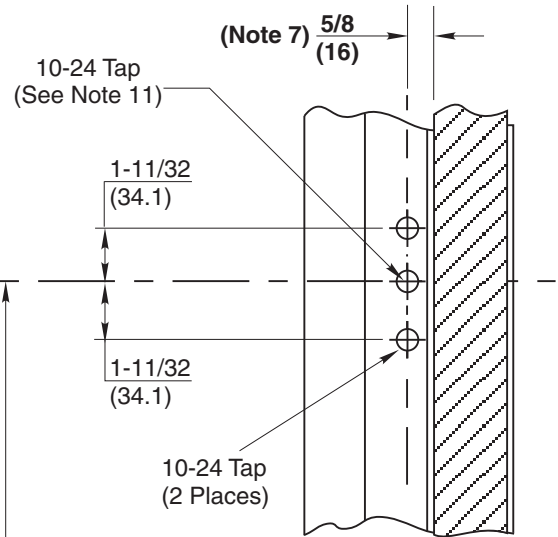


Strike Reinforcement
(See Note 6)

Notes:

1. Do not scale drawing.
2. Dimensions are in inches (mm).
3. LHR door shown. Preparation is typical for both door hands.
4. Minimum door stile width: 4-1/2(114).
5. Prepare mounting holes when installing the device.
6. Unreinforced frames require blind rivet nuts (by others) to mount the strike.
7. Dimension from door face.
8. For outside trim preparation see appropriate trim template.
9. Provide adequate structural support to maintain door integrity after device installation with power tools, door use, or abuse.
10. Device mount to hinge stile (not shown) requires hole location and preparation during device installation. Door structural requirements are similar for both door stiles.
11. These hole(s) MUST be field located using physical part as template, after installation is complete and device is fully operational.
12. Wood screws (by others) permitted for solid core wood doors if pilot holes are used for installation, when door label allows its use. Device: #14x1-1/2" RHWS, interlock: #10x1-1/2" FHWS.

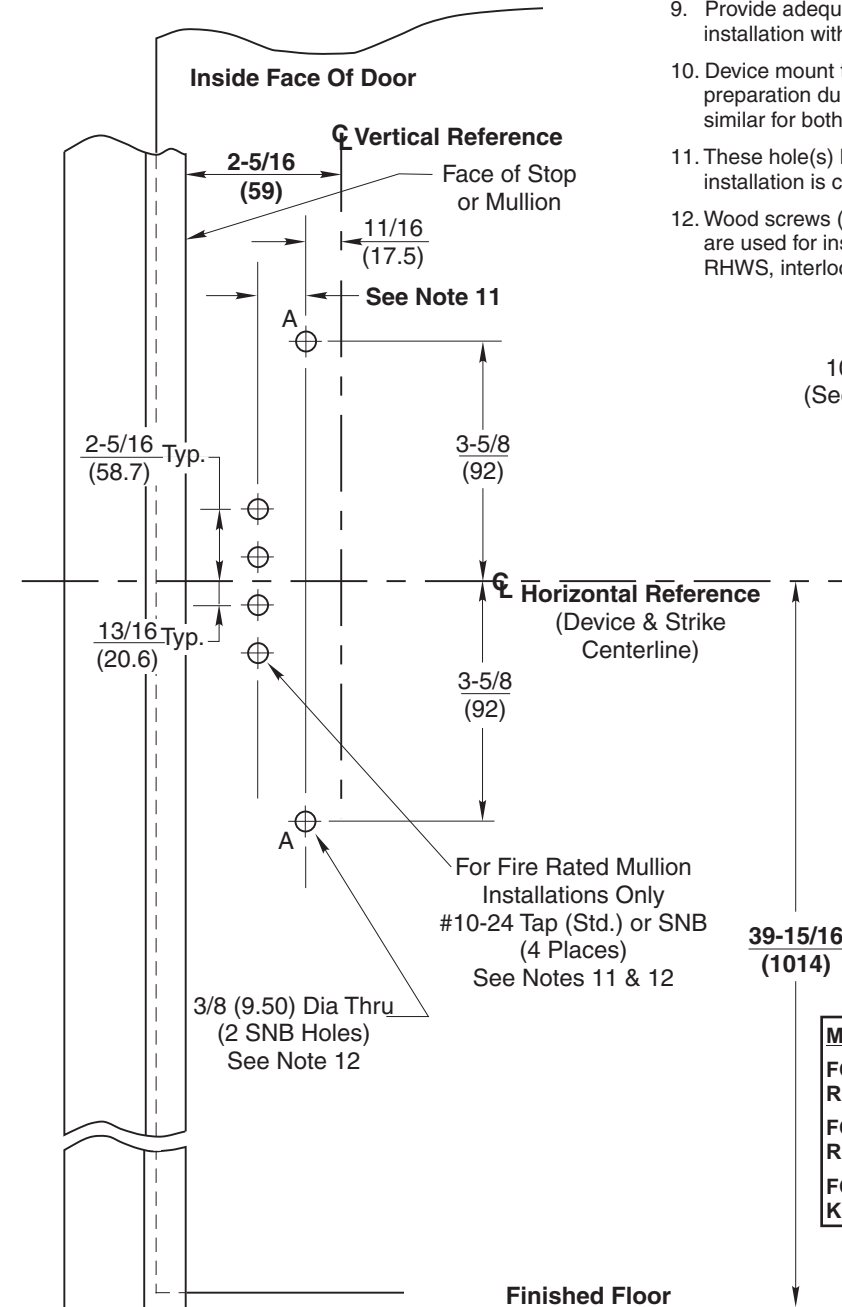

STRIKE PREPARATION DETAILS

MULLION NOTE:

FOR MULLION MODEL NUMBERS M100(F) AND KRM100(F) REFER TO TEMPLATE NUMBER 7400-0100.

FOR MULLION MODEL NUMBERS M200(F) AND KRM200(F) REFER TO TEMPLATE NUMBER 7400-0200.

FOR MULLION MODEL NUMBERS M200FWS AND KRM200FWS REFER TO TEMPLATE NUMBER 7400-0210.

**2100F & 1800F Rim Fire Exit Devices
With 757F Strike**
Application for Fire Labeled Wood or Composite Door
and H.M. Frame or Mullion



100 Yale Ave.
Lenoir City, TN 37771-3226
1-800-438-1951

www.yalelocks.com

TEMPLATE NUMBER

7421-1002

DATE

04-10